
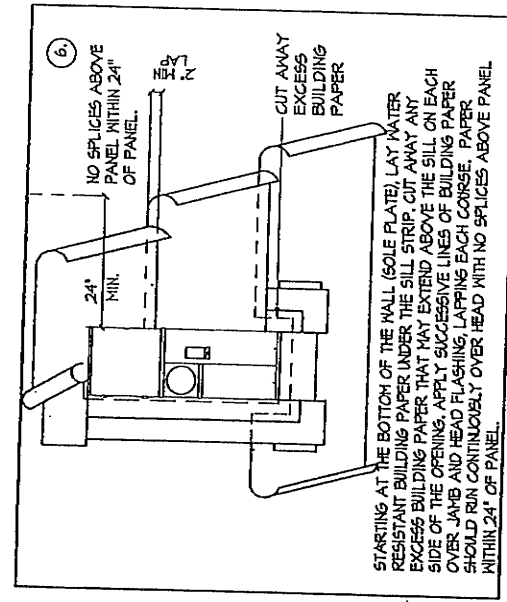
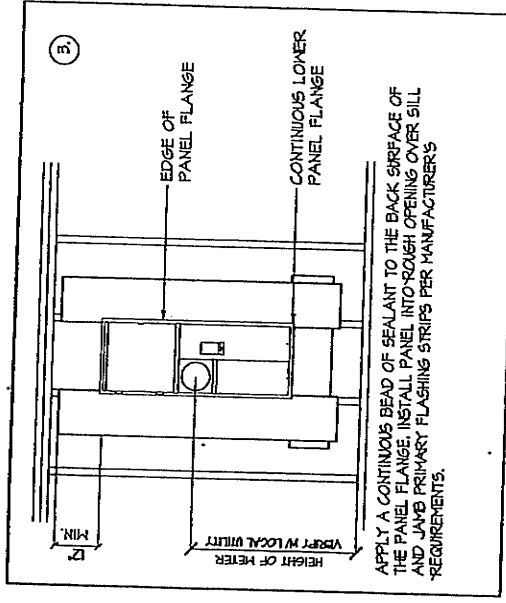
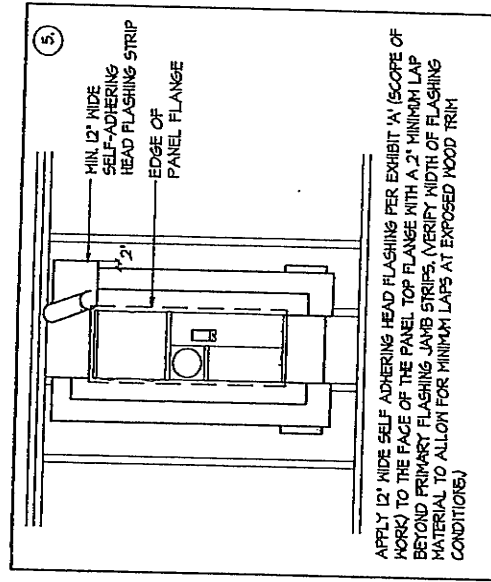
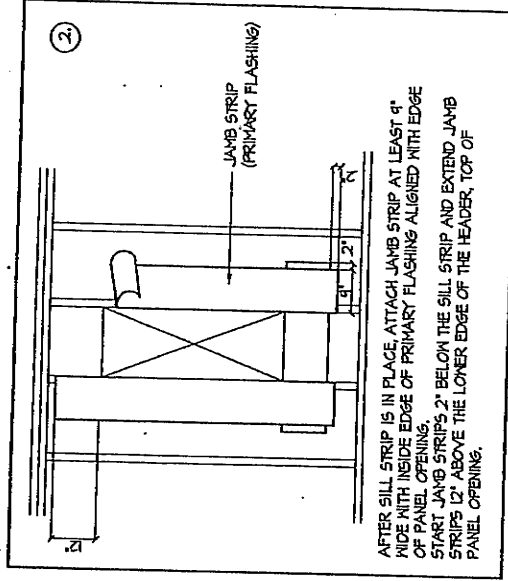
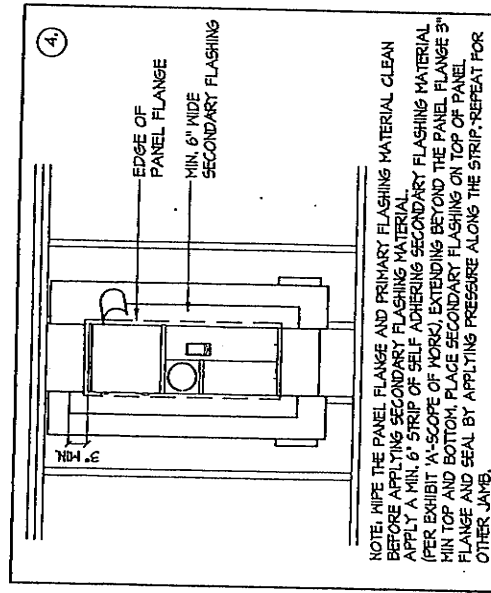


NOTE: SOLID BACKING OR SHEATHING IS REQUIRED BEHIND ALL FLASHING. FLASHING PRODUCTS AND SEALANTS TO BE PER SCOPE OF WORK.

NOTES: CALIFORNIA RESIDENTIAL CODE SECTION R703.9 CALLS FOR FLASHING OF ALL EXTERIOR OPENINGS EXPOSED TO WEATHER TO MAKE THEM WEATHERPROOF. THIS IS OUR REQUIRED PROCEDURE FOR STANDARD FLASHING AT OPENINGS IN WOOD FRAMED EXTERIOR WALLS WHERE THE EXTERIOR WALL FINISH IS APPLIED OVER BUILDING PAPER. CAULK THE BACK OF PANEL FLANGES BEFORE SETTING. USE PANELS THAT ARE RATED FOR EXTERIOR USE AND THAT ARE DESIGNED TO BE RAINTIGHT. THE WIDTH OF FLASHING MATERIAL SHALL PROVIDE FOR A MINIMUM LAP OF 6" AT VERTICAL AND 2" AT HORIZONTAL JOINTS AND OVERLAPS WITH OTHER WEATHER-RESISTANT MATERIALS. LINE-WIRE, WHEN USED AS BACKING TO SUPPORT BUILDING PAPER BENEATH WIRE LATH FOR STUCCO, SHOULD BE INSTALLED ACCORDING TO INDUSTRY STANDARDS AND PRACTICE. NO ATTACHMENT DEVICE NOR THE WIRE BACKING SHOULD COVER OR PENETRATE FLASHING MATERIAL. PERIPHERAL FLASHING AT ALL EDGES OF WALL OPENING MUST COVER THE WIRE BACKING.

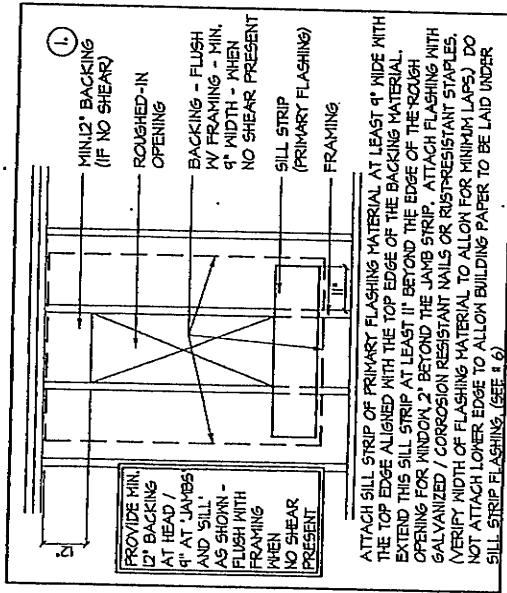

2 FLASHING @ LOAD CENTER

Standard Flashing Material Application at Load Center N.T.S.

An Approved Method